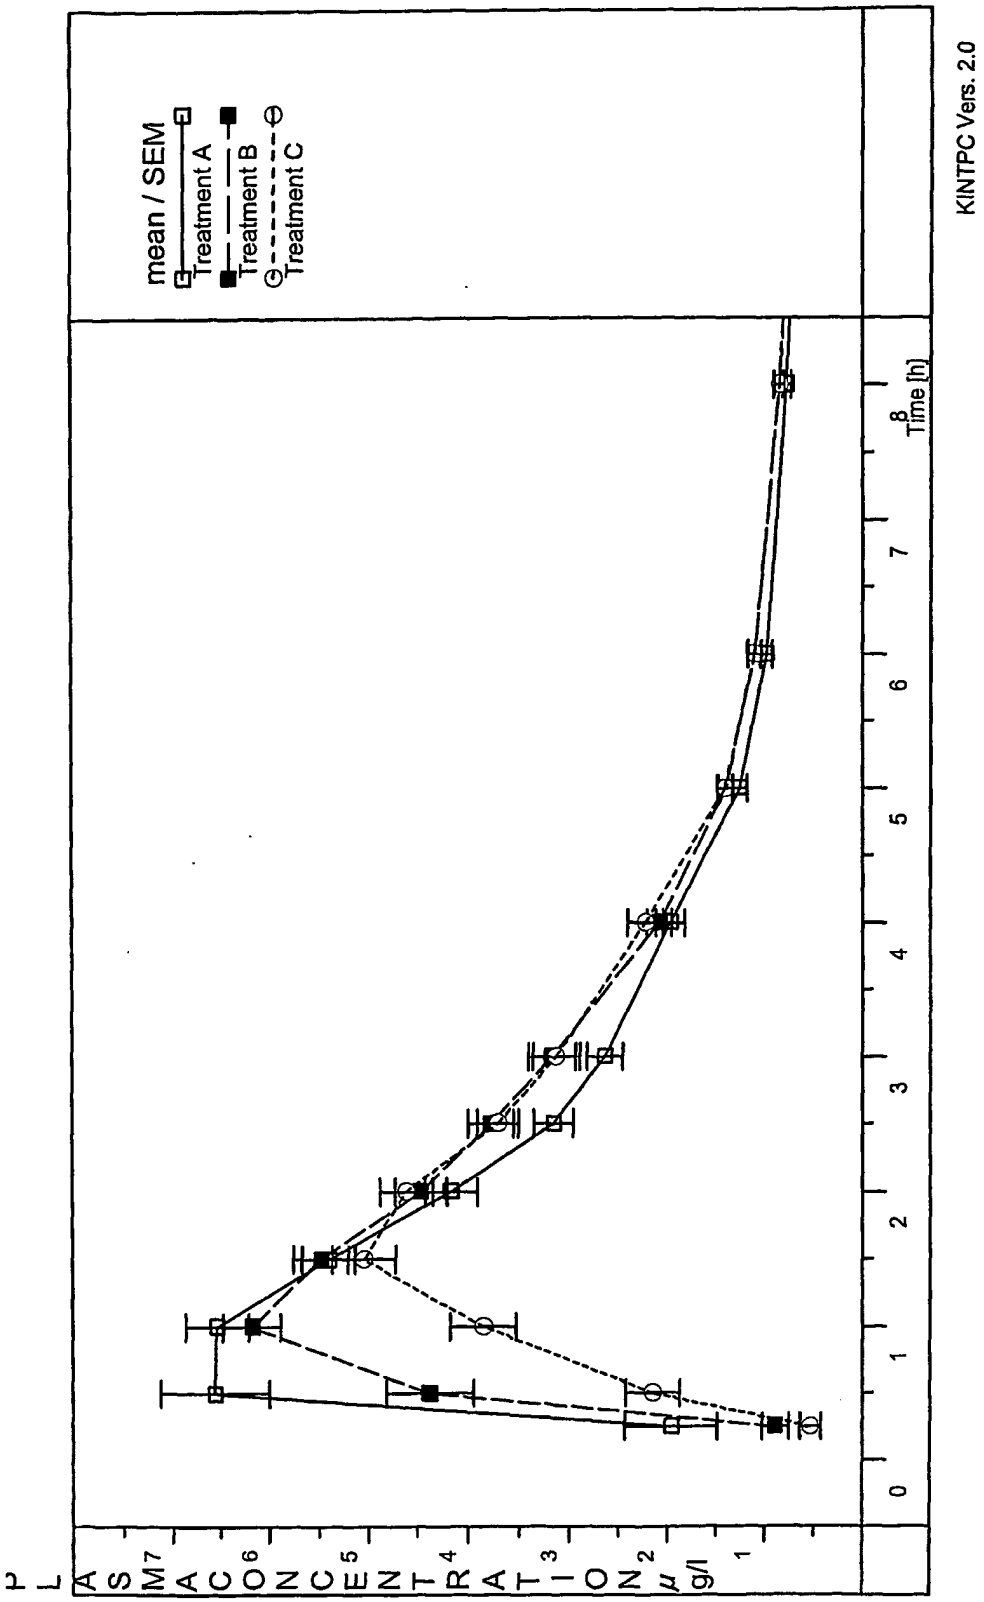
mean / SEM
Treatment A
Treatment B
Treatment C
PLASMA CONCENTRATION µg/l
Time [h]
KINTPC Vers. 2.0

FIG. 1